


UL 924 Standard is Changing

This will change the way you design emergency lighting with the Vive system. In order for emergency lighting products to meet the updated UL 924 standard, the system will have to actively monitor normal power and ensure emergency lighting is deployed within 10 seconds of power loss, maintaining the emergency lighting for a minimum of 90 minutes.



As of April 2022, the Vive Emergency PowPak will no longer carry the UL 924 mark. The Vive Emergency PowPak is still integral to a simple Vive solution for use in emergency lighting systems in accordance with UL 924.

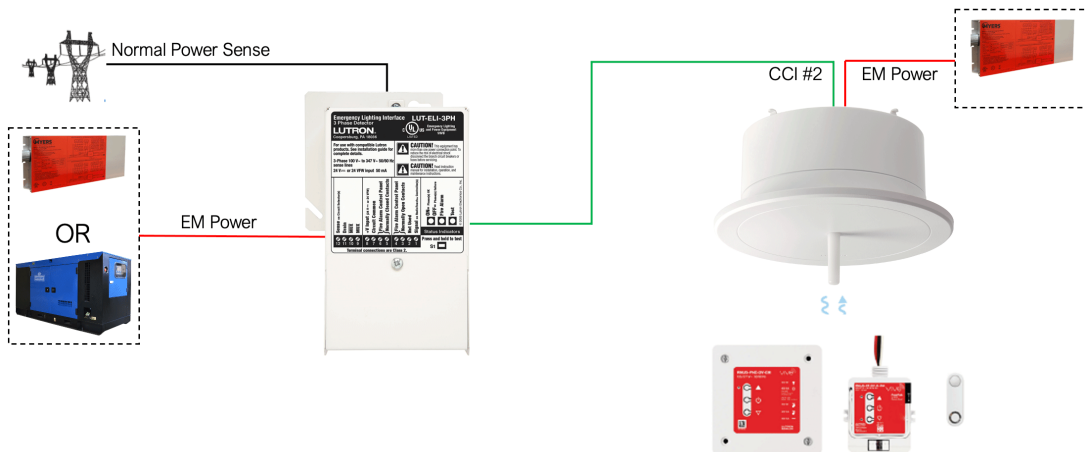

See how to easily design a Vive system in accordance with UL 924 on the next page.

Vive Emergency in 5 Simple Steps!

STEP 1

Install Vive wireless load controllers on normal power



STEP 2

Install Vive emergency (red) wireless load controller on normal/emergency power (either generator or inverter)



STEP 3

Install Vive hub on an uninterruptable power supply



STEP 4

Install and connect the LUT-ELI (Lutron Emergency Lighting Interface) to the Vive Hub



STEP 5

Program the Vive system and configure emergency settings using the Vive app

